




PROTECTIVE DEVICE (VERIFY):
P50850, 65A LINE FUSE

INSTALL & TAG 25KVA 1PH PMT:
75080/27388

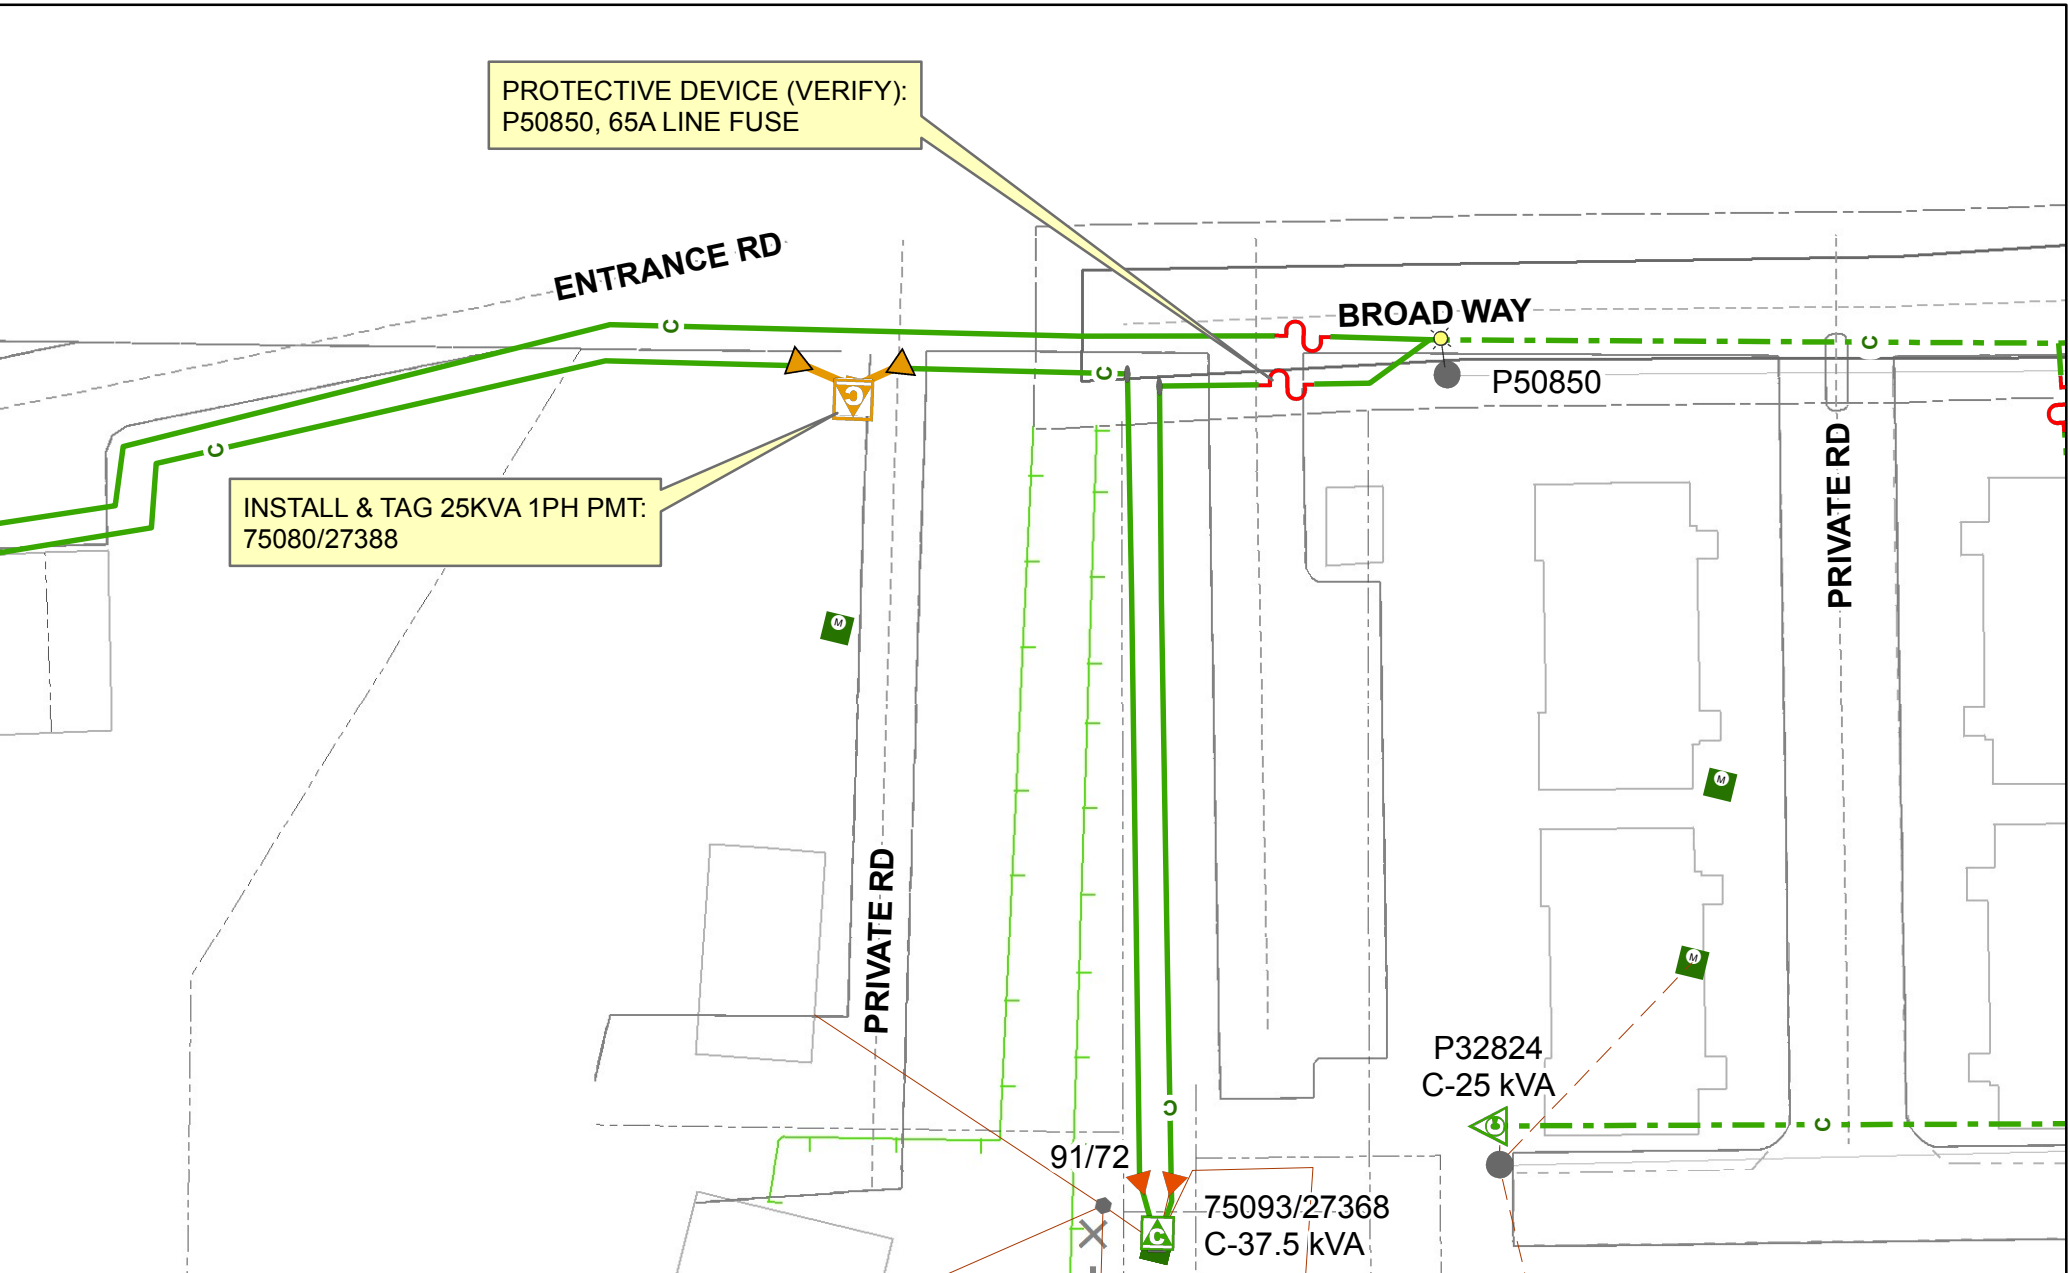

CustPh#:	Customer:	Proj. ID:	 atlantic city electric AN EXELON COMPANY 	
DesgnrPh# (609) 457 - 1272	Address: 104-BROADWAY-	Reference WO:		
DsgnrName: Kabala, Nicholas	City: SOMERS POINT	State: NJ		Scale: 1 inch = 50 feet
CktName: NJ1631	Description: INSTALL 25KVA 1-PH PADMOUNT TRANSFORMER FOR NEW SERVICE @ 104 BROADWAY			
Ckt#: Scull-Patcong				
Protective Device Type: Line Fuse - Verify	Class of Service:	ROW:		
Protective Device ID: P50850 - Verify	Jurisdiction:	Tree:	WSSC:	
Permits:	OH Permits:	UG Permits:	Easement:	
			FR Calorie Count: < 9 - Verify	
			WO # 18385816	
			Date: 11/10/2022	